Draka prysmian

Price List

บริษัท สายไฟฟ้า เอ็มซีไอ ดราก้า จำกัด

No. 1 Wire and Cable Company

@drakabyprysmian

Prysmian Thailand

All Catalogs

01/May/2026

ผู้ผลิตสายไฟคุณภาพระดับโลก ที่ก่อตั้งมานานกว่า **146** ปี

ยอดขายทั่วโลก **>750,000,000,000** บาทในปี **2568**

CONNECTING THE WORLD TODAY AND IN THE FUTURE

กลุ่มบริษัทพรีสเมี่ยน คือผู้นำและเชี่ยวชาญเรื่องสายเคเบิ้ลทั้งด้านพลังงานและโทรคมนาคมของโลกมามากกว่า 140 ปี เราเริ่มต้นจากการรวมธุรกิจระหว่างแบรนด์ Prysmian และ Draka จากนั้นขยายธุรกิจควบรวมแบรนด์ General Cable ทำให้เราสามารถตอบสนองความต้องการของลูกค้า พนักงาน และผู้ถือหุ้นได้อย่างครอบคลุม ปัจจุบันกลุ่มบริษัทพรีสเมี่ยนเป็นบริษัทสายเคเบิ้ลที่มียอดขายอันดับ 1 ของโลก

เรามุ่งมั่นเพื่อรักษาการเป็นผู้นำด้านนวัตกรรมและเทคโนโลยีในการผลิตสินค้าและให้การบริการ โดยมีสาขาทั่วโลกใน 6 ทวีป ซึ่งมีโรงงานผลิตทั้งหมด 112 แห่ง ศูนย์วิจัยและพัฒนา 25 แห่ง และพนักงานผู้เชี่ยวชาญกว่า 30,000 คน

เราค้นหาความต้องการของลูกค้า เพื่อพัฒนาสินค้าและบริการที่ตอบสนองความท้าทายของอุตสาหกรรมต่างๆ ที่เกิดขึ้นในอนาคต

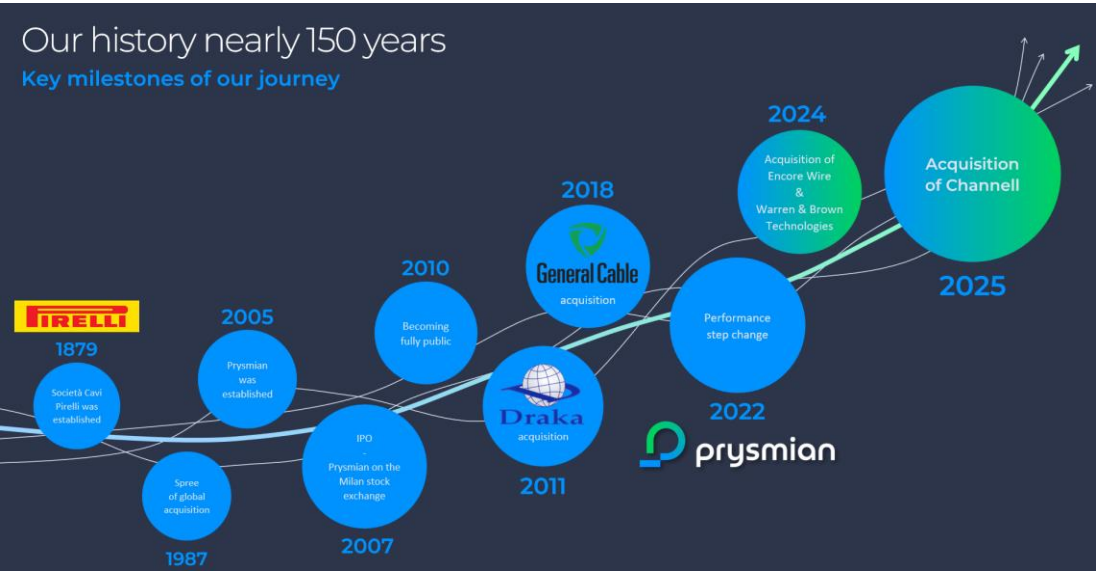

กลุ่มบริษัทพรีสเมี่ยน มีโครงสร้างแบรนด์ 3 ลำดับ ได้แก่

1. แบรนด์องค์กร คือ Prysmian Group ซึ่งเป็นตัวแทนสะท้อนภาพรวมขององค์กรทั้งหมด
2. แบรนด์สินค้าหลัก 3 แบรนด์ คือ Prysmian, Draka, General Cable
3. แบรนด์สินค้าย่อย แบ่งตามตลาดและการใช้งานประเภทต่างๆ

Prysmian Thailand

บริษัท สายไฟฟ้า เอ็มซีไอ-ดราก้า จำกัด เป็นบริษัทในกลุ่มของ Prysmian Group ที่ตั้งอยู่ในประเทศไทย บริษัทฯ เริ่มก่อตั้งตั้งแต่ปี พ.ศ. 2539 สำนักงานใหญ่ตั้งอยู่ที่อาคารกรุงเทพทาวเวอร์ จังหวัดกรุงเทพ และโรงงานผลิตตั้งอยู่ที่อำเภอบ้านค่าย จังหวัดระยอง

บริษัทฯ อยู่ภายใต้กลุ่มภูมิภาคโอเชียเนียและเอเชียตะวันออกเฉียงใต้ ซึ่งประกอบด้วย ประเทศออสเตรเลีย, ฟิลิปปินส์, อินโดนีเซีย, มาเลเซีย, นิวซีแลนด์, สิงคโปร์. และไทย โดยสำนักงานส่วนภูมิภาคตั้งอยู่ที่ประเทศสิงคโปร์

Content

Section 1: Building Wires and Cables
(TIS Standard 11-2553 / 11-2559)

60227 IEC 01 5
60227 IEC 02 6
60227 IEC 05 (IV) 7
60227 IEC 10 (2-4 Cores) 8
60227 IEC 10 (2-4 with Ground) 9
NYY 10
NYY-G 11
60227 IEC 53 (2-4 Cores) 12
60227 IEC 53 (with ground) 13
VCT 14
VCT-G 15

Section 2: Low Voltage Power & Control Cable

CV-FRD 17
CVV 18

60227 IEC 01 (THW)

Application : Building wiring for installation on insulator or in raceway, dry and wet location

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2553 : Part 3, Table 1

Construction : Conductor : Solid or Stranded annealed copper, size 1.5 - 400 mm²
Insulation : Polyvinylchloride (PVC)

Number of Cores จำนวนแกน	Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)
1	1.5	16.40
	2.5	25.00
	4	39.43
	6	64.62
	10	106.18
	16	168.77
	25	265.54
	35	357.86
	50	471.43
	70	671.43
	95	927.86
	120	1,173.91
	150	1,453.00
	185	1,817.14
	240	2,398.77
	300	2,977.86
	400	3,807.91

*กรุณาสอบถามราคาเพิ่มเติมสำหรับสาย LSHF (Low Smoke Halogen Free)

การใช้งาน

- เดินในช่องเดินสายและต้องป้องกันน้ำเข้าช่องเดินสาย
- ห้ามร้อยท่อฝังดิน หรือฝังดินโดยตรง

60227 IEC 02

Application : For making cross connection between terminal inside appliances, instruments or apparatus
Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 750 volts.
Standard : TIS 11-2553 : Part 3, Table 3

Construction : Conductor : Flexible annealed copper, size 1.5 - 240 mm²
Insulation : Polyvinylchloride (PVC)

Number of Cores จำนวนแกน	Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)
1	1.5	19.00
	2.5	28.80
	4	43.16
	6	74.60
	10	119.51
	16	171.39
	25	259.81

*กรุณาสอบถามราคาเพิ่มเติมสำหรับขนาดใหญ่กว่า 25 ตารางเมตรขึ้นไป

การใช้งาน

- เดินในช่องเดินสายและต้องป้องกันน้ำเข้าช่องเดินสาย
- ห้ามร้อยท่อฝังดิน หรือฝังดินโดยตรง

60227 IEC 05 (IV)

Application : Building wiring for installation on insulator or in raceway, dry and wet location

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 500 volts.

Standard : TIS 11-2553 : Part 3, Table 5

Construction : Conductor : Solid annealed copper, size 0.5 - 1 mm²
Insulation : Polyvinylchloride (PVC)

Number of Cores จำนวนแกน	Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)
1	1	11.60

การใช้งาน

- เดินในช่องเดินสายและต้องป้องกันน้ำเข้าช่องเดินสาย
- วางบนรางเคเบิล
- ห้ามร้อยท่อฝังดิน หรือฝังดินโดยตรง

60227 IEC 10

Application : For installation exposed, or in raceway, wet or dry location.

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 500 volts.

Standard : TIS 11-2553 : Part 4, Table 1

Construction : Conductor : Solid or Stranded annealed copper, size 1.5 - 35 mm²
Insulation : Polyvinylchloride (PVC)
Inner sheath : Polyvinylchloride (PVC)
Outer Sheath : Polyvinylchloride (PVC)

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน	3 แกน	4 แกน
1.5	96.20	109.80	126.60
2.5	115.20	134.80	157.60
4	163.00	193.90	233.20
6	225.80	280.00	341.00
10	319.60	410.00	520.40
16	452.40	602.00	784.60
25	665.20	920.20	1,180.80
35	882.20	1,244.60	1,718.00

การใช้งาน

- เดินในช่องเดินสายและต้องป้องกันน้ำเข้าช่องเดินสาย
- วางบนรางเคเบิล
- ห้ามร้อยท่อฝังดิน หรือฝังดินโดยตรง

60227 IEC 10 (2-4 Cores with ground)

Application : For installation exposed, or in raceway, wet or dry location.

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 500 volts.

Standard : TIS 11-2553 : Part 4, Table 1

Construction : Conductor : Solid or Stranded annealed copper, size 1.5 - 35 mm²

Insulation : Polyvinylchloride (PVC)

Inner sheath : Polyvinylchloride (PVC)

Outer Sheath : Polyvinylchloride (PVC)

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน + สายดิน	3 แกน + สายดิน	4 แกน + สายดิน
1.5/1.5	109.80	126.60	178.60
2.5/2.5	134.80	157.60	247.39
4/4	193.90	233.20	365.60
6/6	280.00	341.00	534.40
10/10	410.00	520.40	815.00
16/16	602.00	784.60	1,216.00

การใช้งาน

- เดินในช่องเดินสายและต้องป้องกันน้ำเข้าช่องเดินสาย
- วางบนรางเคเบิล
- ห้ามร้อยท่อฝังดิน หรือฝังดินโดยตรง

NYY

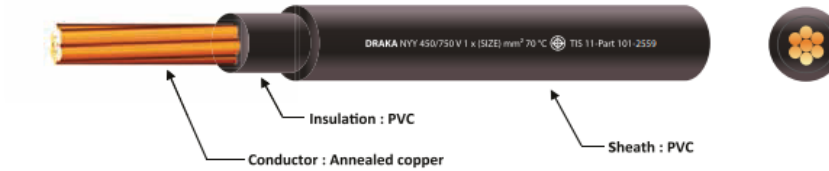

Application : For installation exposed, or in raceway, wet or dry lacation, or direct bury in ground.

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2559 Part, 101 Table 3

Construction : Conductor : Solid or Stranded annealed copper, size 1mm² up to 500 mm²

Insulation : Polyvinylchloride

Sheath : Polyvinylchloride

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)			
	1 แกน	2 แกน	3 แกน	4 แกน
1	45.00	90.19	102.06	116.20
1.5	50.00	100.91	115.19	132.80
2.5	58.40	120.61	141.14	165.00
4	78.80	170.66	203.01	244.16
6	117.60	235.96	292.60	356.34
10	141.00	332.70	426.81	541.74
16	197.60	467.31	621.86	810.50
25	289.20	685.81	948.71	1,217.40
35	392.00	908.66	1,281.94	1,769.54
50	519.40	1,260.60	1,749.40	2,230.00
70	705.60	1,782.00	2,367.40	3,100.00
95	948.00	2,400.00	3,313.80	4,310.00
120	1,216.00	2,980.00	4,184.00	5,452.00
150	1,492.00	3,660.00	5,092.00	6,676.00
185	1,856.00	4,576.00	6,340.00	8,378.00
240	2,418.00	5,984.00	8,290.00	11,038.00
300	3,014.00	7,448.00	10,272.00	13,700.00

การใช้งาน

- วางบนรางเคเบิล
- ร้อยท่อฝังดิน หรือฝังดินโดยตรง

NYY-G

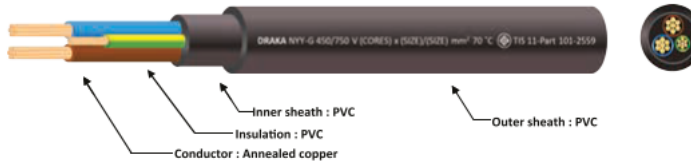

Application : For installation exposed, or in raceway, wet or dry lacation, or direct bury in ground.

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2559 Part 101, Table 5

Construction : Conductor : Solid or Stranded annealed copper, size 1mm² up to 300mm² Ground conductor size1mm² up to 150mm²

Insulation : Polyvinylchloride (PVC)
Inner sheath : Polyvinylchloride (PVC)
Outer Sheath : Polyvinylchloride (PVC)

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน + สายดิน	3 แกน + สายดิน	4 แกน + สายดิน
1/1	102.06	116.20	165.11
1.5/1.5	115.19	132.80	186.64
2.5/2.5	141.14	165.00	257.76
4/4	203.01	244.16	380.59
6/6	292.60	356.34	555.79
10/10	426.81	541.74	846.79
16/16	656.50	850.50	1,291.30
25/16	901.49	1,148.00	1,781.80
35/16	1,214.06	1,680.30	2,568.00
50/25	1,747.96	2,190.00	3,310.00
70/35	2,303.24	3,061.56	4,580.00
95/50	3,200.11	4,219.06	6,310.00
120/70	4,026.00	5,376.21	7,870.00
150/95	4,972.29	6,555.44	9,680.00
185/95	6,068.00	8,195.01	12,030.00
240/120	7,892.00	10,802.21	15,700.00
300/150	9,855.89	13,379.84	19,570.00

การใช้งาน

- วางบนรางเคเบิล
- ร้อยท่อฝังดิน หรือฝังดินโดยตรง

60227 IEC 53

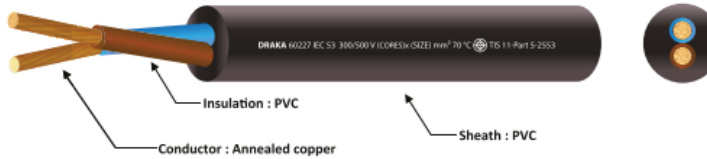

Application : Exposed wiring in air or in raceway, wet or dry location and used for moblie electrical equipment

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 300 volts. TIS 11-2553 : Part 5, Table 9

Construction : Conductor : Flexible annealed copper, size 0.75 - 2.5 mm²
Insulation : Polyvinylchloride (PVC)
Sheath : Polyvinylchloride (PVC)

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน	3 แกน	4 แกน
0.75	44.60	55.80	74.20
1	52.20	70.80	88.20
1.5	69.20	87.80	113.60
2.5	111.40	158.80	177.40

การใช้งาน

- ใช้ต่อเข้าเครื่องใช้ไฟฟ้าชนิดหยิบยกได้
- ใช้ต่อเข้าดวงโคม

60227 IEC 53 with ground

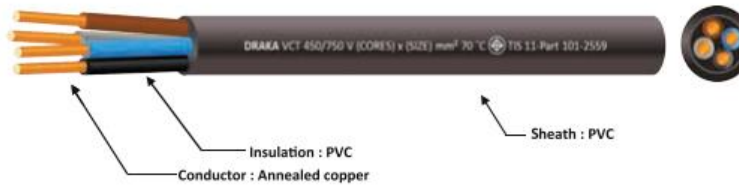

Application : For moblie-electrical eqiupment used in mines, factories, farm or house hold appliances. This cable is particularly suitable for use in chemical factories or in places where cables come in contact with oils.

Classification : Maximum conductor temperature 70°C
Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2559 Part 101, Table 8

Construction : Conductor : Flexible annealed copper, size 1mm² up to 35 mm²
Insulation : Polyvinylchloride
Sheath : Polyvinylchloride

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน + สายดิน	3 แกน + สายดิน	4 แกน + สายดิน
1/1	70.80	88.20	128.00
1.5/1.5	87.80	113.60	159.00
2.5/2.5	158.80	177.40	232.00

การใช้งาน

- ใช้ต่อเข้าเครื่องใช้ไฟฟ้าชนิดหยิบยกได้
- ใช้ต่อเข้าดวงโคม

VCT

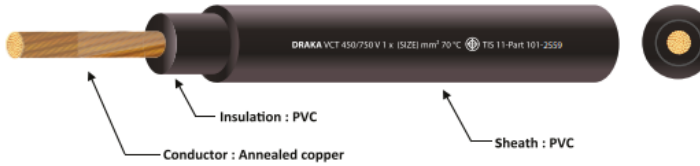

Application : For moblie-electrical eqiupment used in mines, factories, farm or house hold appliances. This cable is particularly suitable for use in chemical factories or in places where cables come in contact with oils.

Classification : Maximum conductor temperature 70°C Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2559 Part 101, Table 7

Construction : Conductor : Flexible annealed copper, size 1mm² up to 35mm²
Insulation : Polyvinylchloride
Sheath : Polyvinylchloride

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน	3 แกน	4 แกน
1	54.90	73.34	91.39
1.5	71.49	90.70	117.34
2.5	114.90	163.80	182.99
4	159.00	200.80	255.00
6	225.80	293.80	382.40
10	390.60	512.60	671.00
16	560.00	758.00	970.80
25	883.00	1,142.00	1,462.80
35	1,170.20	1,596.00	2,036.00

การใช้งาน

- ใช้ต่อเข้าเครื่องใช้ไฟฟ้า
- วางบนรางเคเบิล
- ร้อยท่อฝังดิน หรือฝังดินโดยตรง

VCT-G

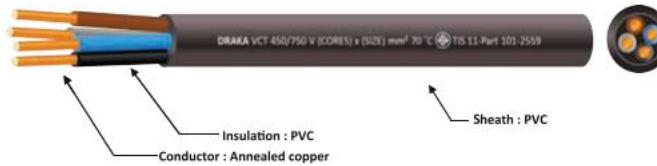

Application : For moblie-electrical eqiupment used in mines, factories, farm or house hold appliances. This cable is particularly suitable for use in chemical factories or in places where cables come in contact with oils.

Classification : Maximum conductor temperature 70°C
Circuit voltage does not exceed 750 volts.

Standard : TIS 11-2559 Part 101, Table 8

Construction : Conductor : Flexible annealed copper, size 1mm² up to 35 mm²
Insulation : Polyvinylchloride
Sheath : Polyvinylchloride

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)		
	2 แกน + สายดิน	3 แกน + สายดิน	4 แกน + สายดิน
1/1	73.34	91.39	133.60
1.5/1.5	90.70	117.34	165.74
2.5/2.5	163.80	182.99	241.51
4/4	200.80	255.00	353.89
6/6	293.80	382.40	600.90
10/10	512.60	671.00	910.00
16/16	758.00	970.80	1,290.00
25/16	1,110.24	1,441.16	1,880.00
35/16	1,540.66	1,984.29	2,630.00

การใช้งาน

- ใช้ต่อเข้าเครื่องใช้ไฟฟ้า
- วางบนรางเคเบิล
- ร้อยท่อฝังดิน หรือฝังดินโดยตรง

Cabling Solutions for the construction world

Draka

CV-FRD (Flame Retardant Property)

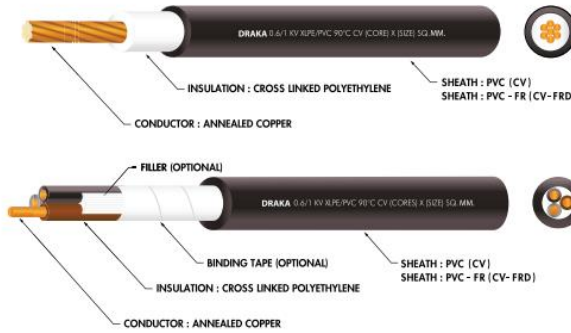

Cross Sectional Area (mm^2) ขนาดพื้นที่หน้าตัด (ตร.มม)	Price (THB/Per Meter) ราคา (บาท/เมตร)			
	1 แกน	2 แกน	3 แกน	4 แกน
2.5	52.59	119.09	148.90	183.79
4	66.36	150.84	194.10	241.99
6	93.63	212.68	276.60	346.88
10	123.69	272.35	374.49	508.40
16	184.22	420.75	573.14	750.55
25	278.82	654.35	887.28	1,160.11
35	375.76	820.24	1,115.70	1,460.74
50	484.00	1,093.91	1,502.59	1,991.74
70	708.73	1,517.51	2,121.64	2,804.11
95	977.87	2,090.90	2,902.90	3,863.64
120	1,239.94	2,635.70	3,694.54	4,912.29
150	1,525.66	3,235.54	4,545.46	6,053.71
185	1,908.00	4,020.60	5,705.46	7,621.00
240	2,518.71	5,257.20	7,448.56	9,979.41
300	3,126.76	6,590.30	9,329.20	13,023.74
400	4,028.33	8,387.61	12,164.94	16,432.99

การใช้งาน

- ใช้งานทั่วไป
- ร้อยท่อฝังดิน หรือฝังดินโดยตรง

CVV

Application : Supervisory electrical equipment, station control circuits. Outdoor, suitable installation in the wet or dry cable trenches.
Classification : maximum conductor temperature 70°C Rated circuit voltage 600 volts.
Testing voltage : 3,500 volts.
Applicable Standard : IEC 60502
Optional Standard : JIS C 3401
Optional : Filler Binder tape

Construction : Number of core : 2-30 cores
Conductor : Annealed copper conductor (Optional : Solid & stranded or Flexible concentric standed.)
Insulation : Polyvinyl chloride colour 2-4 cores : Red, Yellow Blue, Black. more than 4 cores : Black colour with marking core numbers.
Sheath : Polyvinyl chloride (Black colour).

Number of Cores จำนวนแกน	Price (THB/Per Meter) - ราคา (บาท/เมตร) Cross Sectional Area (Sq.mm) - ขนาดพื้นที่หน้าตัด (ตร.มม)				
	0.75 Sq.mm	1 Sq.mm	1.5 Sq.mm	2.5 Sq.mm	4 Sq.mm
2	68.60	73.00	80.60	109.00	149.60
3	76.20	83.80	98.60	137.60	188.60
4	95.60	98.80	119.60	170.60	251.20
5	116.60	130.00	152.40	218.40	305.00
6	131.10	153.50	184.50	271.00	381.40
7	137.60	157.00	188.60	275.60	397.80
8	201.43	210.70	255.70	361.60	502.10
9	206.43	212.40	258.80	367.60	526.40
10	211.43	228.80	280.80	403.60	580.00
11	216.60	255.00	314.90	465.00	672.20
12	219.80	257.20	317.00	466.40	684.40
13	241.70	279.10	350.90	520.80	766.30
14	243.60	281.00	352.80	523.20	772.20
15	258.60	305.40	388.40	580.10	878.00
16	261.60	307.80	390.00	585.00	891.80
17	288.74	332.40	430.46	623.94	945.46
18	293.74	346.40	444.26	677.54	1,006.86
19	297.40	351.60	449.00	683.80	1,034.80
20	333.20	393.70	494.40	750.70	1,135.40
21	335.40	397.80	501.80	759.20	1,144.00
22	362.74	431.26	542.54	839.06	1,240.26
23	367.74	437.66	557.54	862.66	1,271.66
24	371.80	439.40	561.60	878.80	1,294.80
25	400.86	470.00	603.46	948.80	1,390.66
26	409.86	474.40	618.46	960.40	1,424.06
27	413.40	478.40	624.80	968.80	1,444.40
28	438.14	510.74	665.26	1,040.34	1,539.34
29	439.14	518.14	680.26	1,055.94	1,578.74
30	442.00	523.40	683.80	1,063.40	1,591.20

การใช้งาน

- ใช้เดินในวงจรควบคุม ภายในอาคาร

prysmian

KEY FACTS

PRYSMIAN Group · Draka · General Cable

since 1879 — Over 140 years old company

Prysmian Group · World's No.1 Cable

www.prysmiangroup.com

MCI-Draka Cable Co., Ltd.

Bangkok Office
18th Floor, Bangkok Tower 2170 New Petchburi Rd., Bangkapi Huaykhwang, Bangkok 10310 (Head Office) T +66 (0)2308 0830-2 / F +66 (0)2308 0054

Rayong Plant
2/7 Moo 2 Banbueng – Bankhai.Rd., Km.57 Tambon Nongbua, Amphur Bankhai, Rayong 21120
T +66 (0)38 988 3348-50 / F +66 (0)38 961 167

THAILAND

Utility & Infrastructure
APM Suwannabhumi Phase 2
Bangkok Gold Line Thonburi to Klong - Sarn (BTS)
BEM - Blue Line Extension / Green Line
BTS - Orange Line
BTS - Pink and Yellow Line
Central Pattaya Tunnel
Electricity Generating Authority of Thailand - Control and Power Cable
"Expressway Authority of Thailand : Variable Message Sign
: VMS Chalongrat routh : Emergency line Buraphavitee : MTC/ECT : Maintained"
Metropolitan Electricity Authority - Substations
MRT Blue line (BL11-BL28 Stations and Depot)
SRT - Red line Contract 2
Tunnel @Pattanakarn
Tunnel_226 @ Nakhon Ratchasima
U-TAPAO International Airport
Water Tunnel Bung Nongbon
Water Tunnel Mae Ngad Dam (Mae Ngud - Mae Tang)

Building
AIA Capital Center
Amari Samui
Ashton Chula Silom
Assumption University - Bang Na Campus
Bangkok Hospital China Town
Bangkok Patana International School
Banyan Tree
Big C Supercenter
Burapha University
Central Hadyai, Pattaya, Rama9
Chulalongkorn University
CIMB Office
Department of Highways Office
Gateway Bang Sue
Government Saving Bank - Office Renovation
Hadyai University
Hilton Hotel Bangkok
IDEO S11, S11, Sathon-Wongwainyai
I'm park Samyan
Kasetsart University
K-BANK
Khon Kaen University
Laguna Phuket
Landmark Waterfront
LIFE Asoke, Ladprao
Lotus Aran, Lumlukka, Prachinburi
LPN Had Jomtien, Lasalle, Pataya, Rama9
Mahidol University
Market CPN
Marriot Phuket
Millennium Building
Ministry of Justice - New office
Ministry of Public Health - New office
Nakornpathom Hospital
Narathiwas University
NIDA Building
Provincial Administrative Organization, Nonthaburi
Rangsit Hospital
Rangsit University
Regent Condo 3, Home 22
Rhythm Ari
Royal Residence Bangkok
Ruamrudee International School
SALA CHAWENG
SB Design Rama2
Sea Front Hotel Chonburi
Seven Sea Pattaya
Sikarin Hospital 14
Silom Building
Silpakorn University
Somerset Suanplu
Srinakarinviroj University
Suvarnabhumi Institute of Technology@Huntra Center
Swan Lake Khoayai
Talad Thai I+II
Tempo Grand Sathorn Wutthakat
Tesco Lotus Lot 18
The Address
The Bangkok Marriott Marquis Queen's Park
The Key BTS Wutthakat
The Line Asoke, Phahon Pradipat, Sathorn, Phahon Pradipat
The Market Bangkok
The Nature
The Niche
The Niche Mono
The PARQ
The President - Sathorn Ratchada
The Regent
The Sky Sukhumvit 103
The Trust Amata Chonburi
TMB Office Building
TOT Office Building
Town Hall - Nan
WAT PRATUMWANARAM
WAT THAMMAKAYA
Zoo @ Korat

Industry
Ajinomoto Factory
AMATA Rayong
Bang Pakong Power Plant - Combined Cycle
DAISIN Industrial
Ford Moter Industry
Fuji Electronic
Glow Power 115 MW CFB#3
GPSC CUP 4 Project
Hongsa Power - Mining Equipment Extension
IRPC Industry
Kerry Logistic
Kuraray GC - Harmony
NISSAN Factory
Pinthong IEs
PTT ESP & GSP#6 Plant
PTT LNG Nong Fab
PTT Phenal Plant
SCG Long Son LDPE
Siam Cement Group - THPP#3
SIAM SAAG Industry
SINOPEC-ISBL : ROCC Project (IRPC)
Thai Oil Clean Fuel Project
Thai Oil Jetty
Thai Red Cross Society
Thappline - Ethanal & Gasohol

Telecom
CAT Telecom - Data Center Expansion and Fiber Optic patch cord
CCTV EGAT
Fiber Optic - Advance Info Service
Fiber Optic - Dhammakaya Foundation & Wat Phra Dhammakya
Fiber Optic Cable - Laos Telcom
Fiber Optic Cable - Star Petroleum Refining Public Co.,Ltd.
Fiber Optic Cable - True Coreporation
Fiber Optic Cable - United Information Highway
Network Switch Infrastucture - BPS United
SME Data Center - SME bank
Wireless System - Phattahlung Hospital

Solar
GUNKUL - Solar Rooftop
Hompro - Solar Rooftop
Industrial Rooftop Solar - CP Group
Industrial Rooftop Solar - SCG
Kasetchai Farm - Solar Rooftop
KPN Green Energy - Solar Rooftop
Neo Clean Energy - Solar Rooftop
Pea Encom Ricemill - Solar Rooftop
RATCH - Solar Floating
Thai Food - Solar Floating
Thai Honda - Solar Rooftop
Thaisun - Solar Rooftop
Toyota - Solar Rooftop
VON(Udonthani) - Solar Rooftop

ASEAN

Australia Embassy - Indonesia
Bank Negara Malaysia, Cyberjaya
BASF Gebeng, Petronas
Breadtalk HQ
British Embassy - Indonesia
Can Tho Airport
Changi Airport Group
Changi Prison HQ
Circle Line Stage 3, 4, 5 (Electrical), C830, C414
Civil Aviation Authority of Singapore - Changi Airport T5
Co Chien Bridge
Data Centre at Surabaya
Deutsche Bank @ Mapletree Business City
DHL @ Greenwich Drive Tampines Logispark
Downtown Line signal package, C955, C956, C960, C961
Downtown Line Stage 1, 2, 3
DUCHUE 2 SOLAR FARM
Dung Quat Oil Refinery
Dung Quat Refinery's Sulfur Recovery Unit 2 (Sru2)
Exxon Mobile Singapore Parallel Trains 1 & 2, Jurong Island
Formula One - Singapore GP
Gardens by the Bay
GOOGLE Data Center
Hanoi Museum
Ho Chi Minh City Urban Railway (Line1)
Holcim Plant
Hong Leong Data Center
IndoChina Plaza Hanoi
Marina Bay Sands Integrated Resort
Marina Coastal Expressway C461, C466
MCOT Petronas
Ministry of Defense Vietnam - Naval Base Power Supply
Nam Con Son Gas Pipelines
National Centre For Infectious Diseases
National University Hospital
Noi Bai Airport - Terminal 2
North South Line Extension (Mechanical), C1563
North, South, East, West Re-signaling Project
PAJAM, Solar Farm
Penjuru Terminal
Petrochamical Complex in South of Vietnam - Package 6
Central Utility Plant (VLSU)
Petronas Refinery Melaka
Petronas Twin Towers
Raub Australian Gold Mine Project
Republic of Singapore Navy Littoral Mission Vessels
RMIT University HCM
Savvis Datacenter
SG2 Equinox Datacentre
Shell Bukom C2 Jetty
Shell Houdini, Bukom Refinery
Shell MEG Air Liquide Project
SILOAM Hospital
Singapore General Hospital
Tan Son Nhat Oil Storage
Tenaga National Berhad SCADA System
Thai Binh - Ham Rong Gas Pipelines, Gas Distribution & Gathering System
TRUNG NAM - THUAN NAM SOLAR POWER PLANT
Vietcombank Tower HCM

GLOBAL

Athlone Shopping Centre - Ireland
Basslink Interconnection - Victoria and Tasmania, Australia
Burj Dubai Tower - The World's Tallest Tower
Germany North-South HVDC Interconnection - A-Nord, SuedOst Link and SuedLink
Guggenheim Museum, Bilbao - Spain
Hamburg International Airport - Germany
Hudson River Interconnection - New York and New Jersey
Interconnection the Greek Cyclades islands Evia, Andros and Tinos
Istanbul national museum - Turkey
Madrid-Barajas Airport - Spain
Offshore Wind Farm - BorWin2, BorWin3, HelWin1, HelWin2, SylWin1, and DolWin3
One World Trade Center - New York
SA.PE.I. Interconnection - Sardinia and the Italian mainland in Lazio